


SafeWork SA

information > advice > support

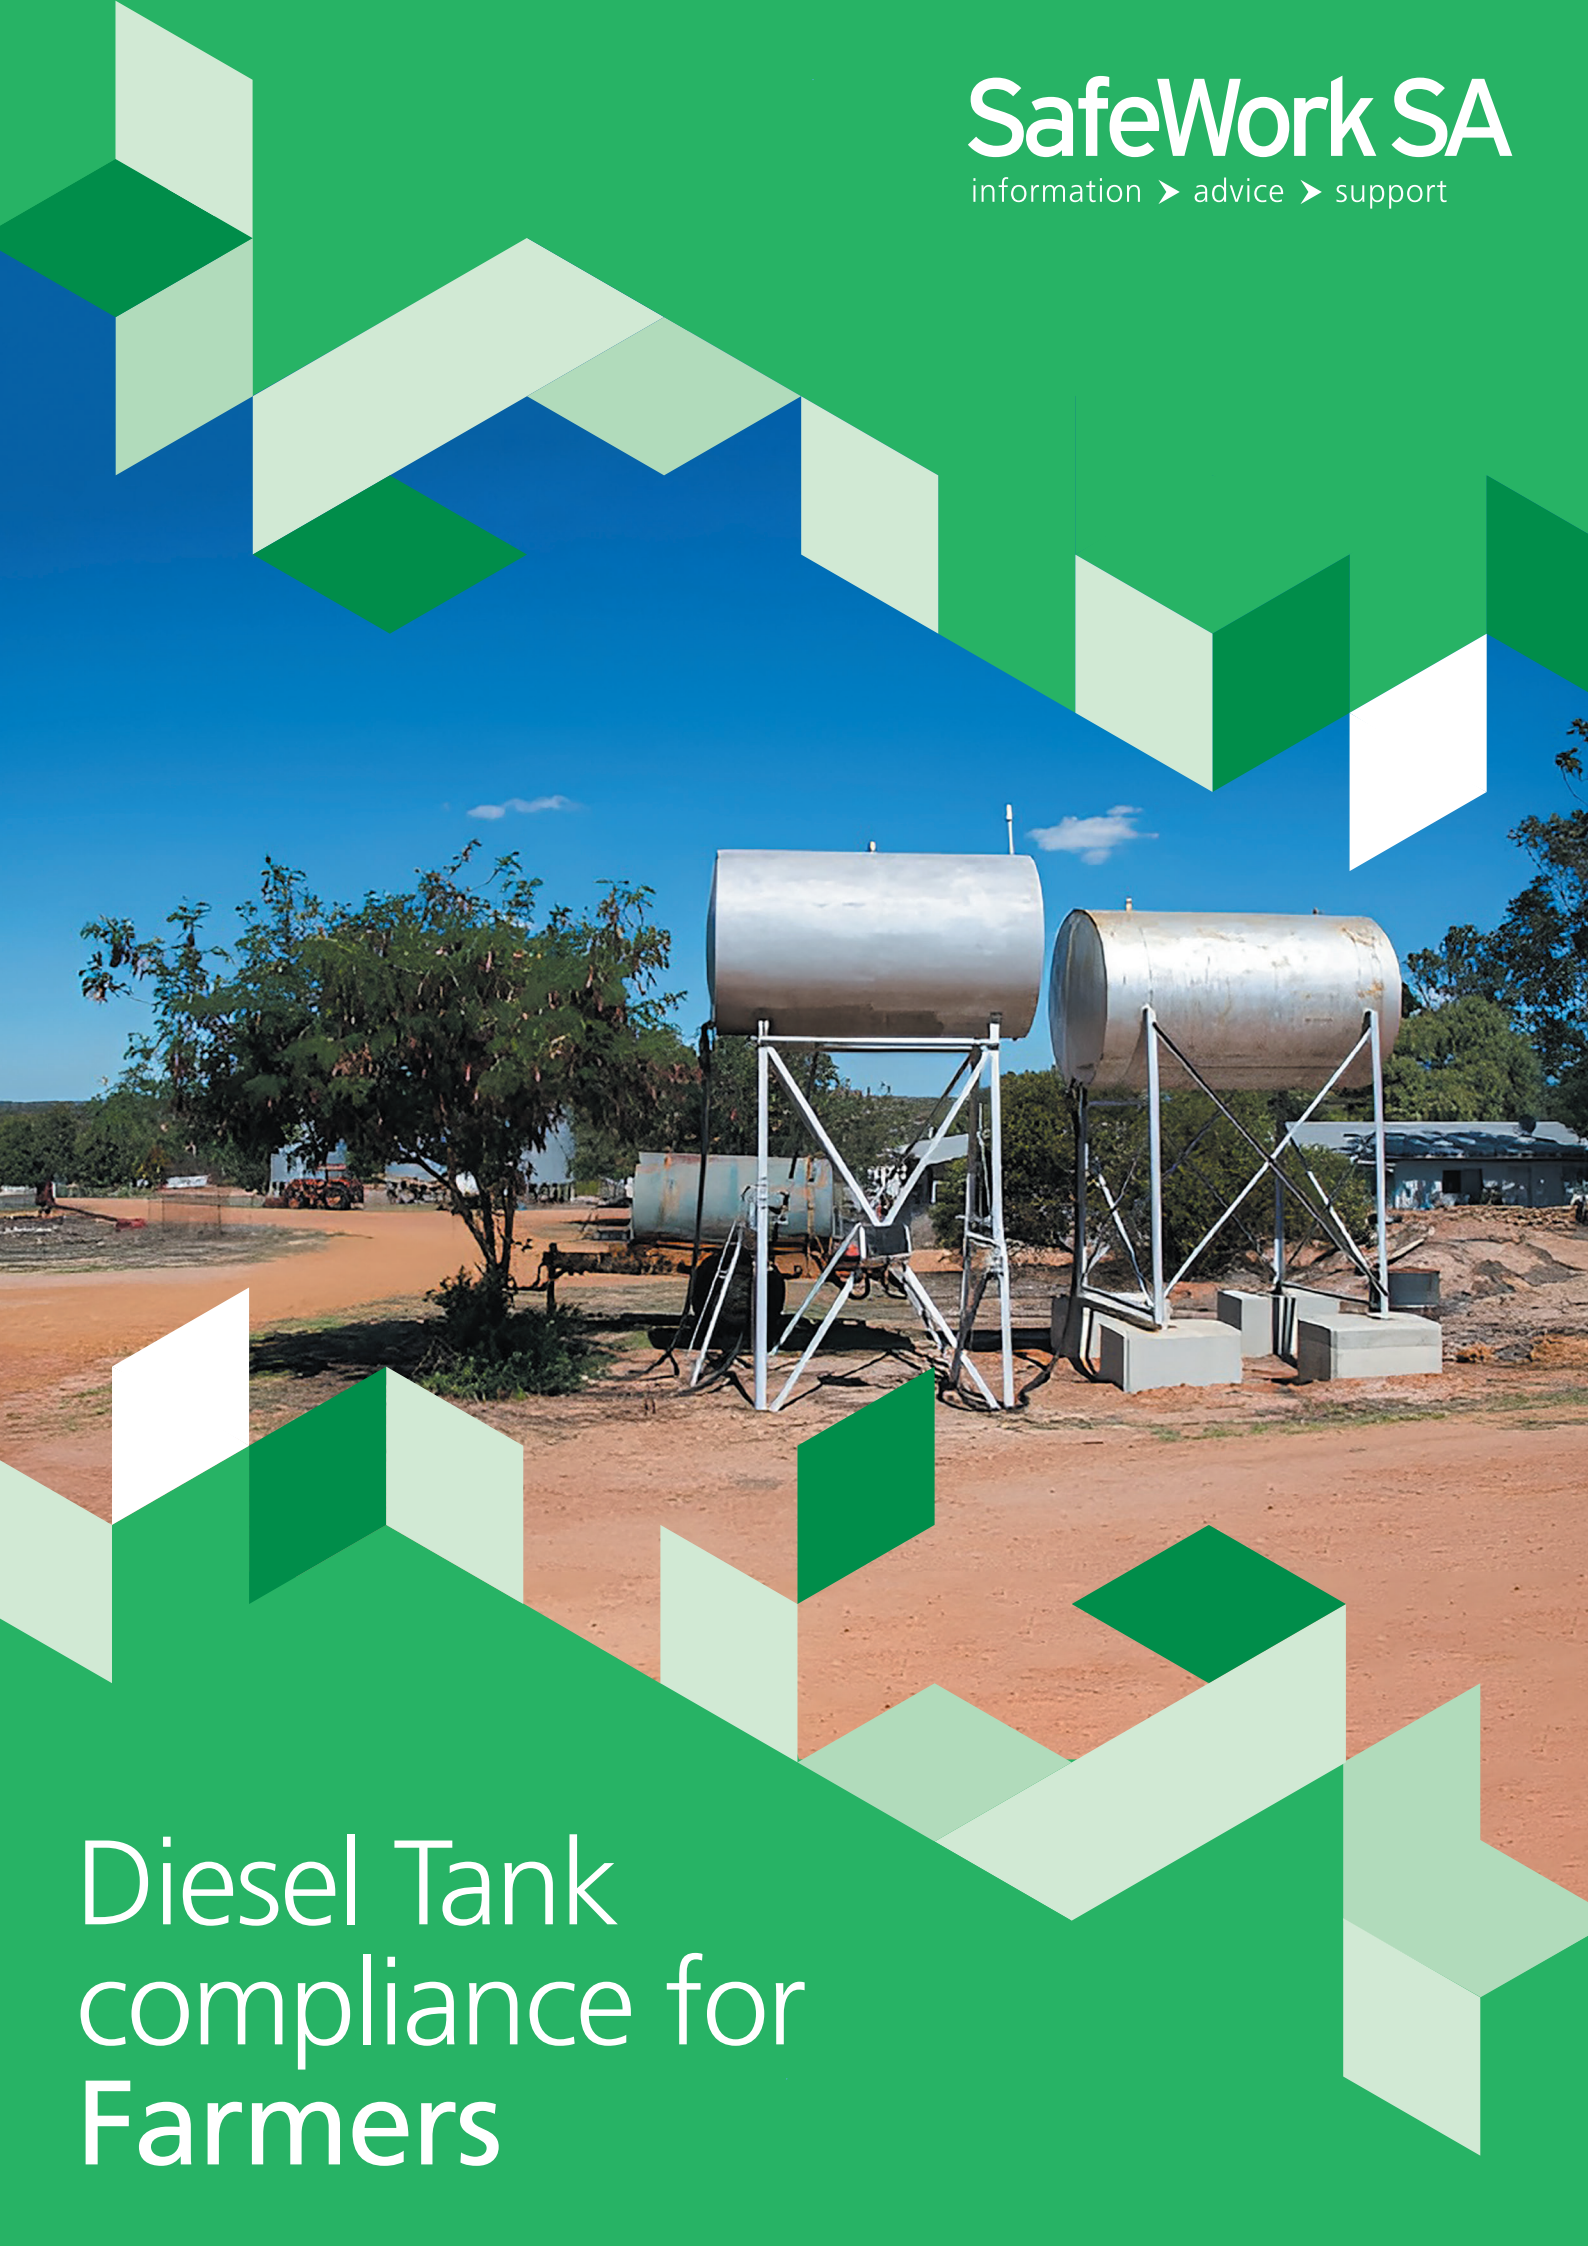

# Diesel Tank compliance for Farmers

1. The Person Conducting a Business or Undertaking (PCBU) must have a placard prominently displayed on or near each diesel tank. (Combustible liquid)



2. Safety signs must be displayed warning of particular hazards associated with diesel. E.g. Stop engine, turn off electrical devices, approved containers only and no smoking.



3. Signage with emergency contact details and phone number must be displayed.



4. The PCBU must ensure the workplace has fire protection, firefighting and safety equipment that is designed and built for the types of hazardous chemicals at the workplace.
5. Fire equipment must be accessible for persons at the workplace.

6. Fire equipment must be checked and tested with records kept. Equipment must be readily available and workers trained in its usage.
7. Electrical dispensers must have an emergency stop button. (coloured red) with emergency stop signage displayed.
8. The PCBU must have a hazardous chemical register.
9. The PCBU must have a current SDS (Safety Data Sheet) for each hazardous chemical on site.
10. Tanks and any associated pipe work attached must be protected against any impact or excessive loads.
11. The PCBU must have a spill containment system in place.
12. The PCBU must ensure that the spill containment system does not create a hazard by bringing together incompatible hazardous chemicals.
13. The PCBU must have inspection records for the tank and associated plant (as per manufacturers specifications).

#### If quantities exceed 10,000l storage:

14. The PCBU must have Hazchem signs displayed at each entrance to the site where emergency services may enter.



15. An emergency plan must be prepared for site and tested. Information training and instruction must be given to workers in relation to implementing the emergency plan.